

IS : 3629 - 1986

(Reaffirmed 1995)

Indian Standard

SPECIFICATION FOR
STRUCTURAL TIMBER IN BUILDING

(*First Revision*)

Second Reprint JANUARY 1998

UDC 691.11 : 674.03

© *Copyright* 1987

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BHADUR SHAH ZAFAR MARG
NEW DELHI 110002

Indian Standard

SPECIFICATION FOR STRUCTURAL TIMBER IN BUILDING

(*First Revision*)

Building Construction Practices Sectional Committee, BDC 13

Chairman

SHRI C. P. MALIK
C-4/38, Safdarjung Development Area
New Delhi 110016

Members

ADDITIONAL DIRECTOR, ARCHITECTURE
JOINT DIRECTOR, ARCHITECTURE (*Alternate*)
SHRI P. D. AGARWAL

SUPERINTENDING ENGINEER (*Alternate*)
SHRI K. BALBIR SINGH
SHRI M. V. BHIDE (*Alternate*)
SHRI D. R. BATLIWALA
SHRI B. K. CHAKRABORTY

SHRI V. K. GROVER (*Alternate*)
CHIEF ENGINEER

SHRI A. V. GOPALKRISHNA (*Alternate*)
CHIEF ENGINEER

SUPERINTENDING ENGINEER
(S&S) (*Alternate*)
CHIEF ENGINEER (BLDGs)

SUPERINTENDING ENGINEER
(SPECIAL BUILDING CIRCLE) (*Alternate*)
CHIEF ENGINEER (TRAINING)

SUPERINTENDING ENGINEER
(TRAINING) (*Alternate*)
DR M. P. DHIR

Representing

Research, Designs and Standards Organization
(Ministry of Railways), Lucknow

Public Works Department, Government of Uttar Pradesh, Lucknow

Life Insurance Corporation of India, Bombay

Bhabha Atomic Research Centre, Bombay
Housing and Urban Development Corporation Ltd,
New Delhi

Engineer-in-Chief's Branch, Army Headquarters,
New Delhi

Public Works Department, Government of Rajasthan,
Jaipur

Public Works Department, Government of Tamil Nadu, Madras

Central Public Works Department, New Delhi

Central Road Research Institute (CSIR), New Delhi

(*Continued on page 2*)

© Copyright 1987

BUREAU OF INDIAN STANDARDS

This publication is protected under the *Indian Copyright Act* (XIV of 1957) and reproduction in whole or in part by any means except with written permission of the publisher shall be deemed to be an infringement of copyright under the said Act.

(Continued from page 1)

<i>Members</i>	<i>Representing</i>
SHRI S. S. GILL	Public Works Department, Government of Punjab, Chandigarh
SHRI K. M. JHA	National Industrial Development Corporation Ltd, New Delhi
SHRI G. B. JAHAGIRDAR (<i>Alternate</i>)	
SHRI M. KARTIKAYAN	Builders' Association of India, Bombay
SHRI R. L. KUMAR	Institution of Surveyors, New Delhi
SHRI V. G. PATWARDHAN (<i>Alternate</i>)	
SHRI G. K. MAJUMDAR	Hindustan Prefab Ltd, New Delhi
SHRI H. S. PASRICHA (<i>Alternate</i>)	
SHRI R. C. MANGAL	Central Building Research Institute (CSIR), Roorkee
SHRI J. S. SHARMA (<i>Alternate</i>)	
SHRI H. N. MISHRA	Forest Research Institute and Colleges, Dehra Dun
SHRI K. S. PRUTHI (<i>Alternate</i>)	
SHRI M. N. RAJARAMAN	Raman Brothers, Madras
SHRI A. S. VASAN (<i>Alternate</i>)	
SHRI S. G. RANADIVE	Indian Institute of Architects, Bombay
SHRI RUMMY SHROFF (<i>Alternate</i>)	
SHRI T. S. RATNAM	Bureau of Public Enterprises, Ministry of Finance
SHRI P. R. KALRA (<i>Alternate</i>)	
SHRI P. K. SINGHA ROY	State Bank of India, Bombay
SHRI K. S. SRINIVASAN	National Buildings Organization, New Delhi
DEPUTY DIRECTOR (<i>Alternate</i>)	
SHRI SUSHIL KUMAR	National Buildings Construction Corporation Ltd, New Delhi
SHRI S. R. TAMBE	Public Works & Housing Department, Bombay
SHRI B. T. UNWALLA	Institution of Engineers (India), Calcutta
SHRI G. RAMAN, Director (Civ Engg)	Director General, ISI (<i>Ex-officio Member</i>)

Secretary

SHRI A. K. SAINI
Deputy Director (Civ Engg), ISI

Timber Engineering Subcommittee, BDC 13 : 4

Members

SHRI A. N. BAJAJ	In personal capacity (<i>ED/117, Tagore Garden, New Delhi</i>)
SHRI S. C. CHAKRABARTI	Central Building Research Institute (CSIR), Roorkee
DR Y. SINGH (<i>Alternate</i>)	
SHRI V. N. DESHPANDE	Engineer-in-Chief's Branch, Army Headquarters, New Delhi
SHRI S. K. GUPTA (<i>Alternate</i>)	

(Continued on page 31)

Indian Standard
SPECIFICATION FOR
STRUCTURAL TIMBER IN BUILDING
(First Revision)

0. FOREWORD

0.1 This Indian Standard (First Revision) was adopted by the Indian Standards Institution on 25 March 1986, after the draft finalized by the Building Construction Practices Sectional Committee had been approved by the Civil Engineering Division Council.

0.2 Timber on account of its non-homogeneous character and the inherent natural defects is generally considered with doubt by the engineers and builders for permanent structures. Conventional ways of working with timber have resulted in wastage of material and labour. Although wood like other materials of nature is subject to attack by various destructive agents, it is now well known that techniques are available to prolong its life so that various practical service requirements can be met with. Developments in the field of timber engineering have helped in wise and economic use of timber for structural purposes.

0.3 This standard was originally published in 1966. The present revision has been undertaken to incorporate the developments and data now available on strength characteristics, durability and treatability of more species. The important changes made in the revision are updating of grouping of timbers for structural use with presently available data and enlisting of permissible defects of timber.

0.4 For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS : 2-1960*. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

*Rules for rounding off numerical values (revised).

1. SCOPE

1.1 This standard covers the various requirements of structural timber for use in buildings. It includes classification and grouping of different species of timber, their suitability for permanent and temporary structures, factors affecting strength, tolerances on dimensions, influence of defects and allowance for such defects in timber.

2. TERMINOLOGY

2.0 For the purpose of this standard, definitions given in IS : 707-1976*, IS : 883-1970† and the following shall apply.

2.1 Permanent Structures — Structural units in timber which are constructed for a long duration and wherein adequate protection and design measures have initially been incorporated to render the structure serviceable for the required life.

2.2 Temporary Structures — Structures which are erected for a short period, such as hutments at project sites, for rehabilitation, temporary defence constructions, exhibition structures, etc.

3. MATERIAL

3.1 Species of Timber — The species of timber recommended for various constructional purposes are given in Table 1. For availability and general characteristics like durability, treatability, refractoriness, etc. of these species reference may be made to IS : 399-1963‡ and IS : 401-1982§. For safe working stresses, reference may be made to IS : 883-1970†. Species of timber other than those mentioned may be used provided the basic strength characteristics are determined to satisfy the limits as specified under **4.2** and also the general principles of designing outlined in IS : 883-1970† are followed.

NOTE — For obtaining strength characteristics of the unlisted species, a reference may be made to the Forest Research Institute and Colleges, Dehra Dun.

3.1.1 Timber species may be identified in accordance with good practice. References may also be made to IS : 4970-1973||.

3.1.2 Different species of structural timber may be classified according to their:

- a) strength characteristics (see **3.1.3**, **4.2** and **5**);
- b) durability (see **3.3.1**); and
- c) treatability (see **3.3.3**).

*Glossary of terms applicable to timber technology and utilization (*second revision*).

†Code of practice for design of structural timber in building (*third revision*).

‡Classification of commercial timbers and their zonal distribution (*revised*).

§Code of practice for preservation of timber (*second revision*).

||Key for identification of commercial timbers (*first revision*).

TABLE 1 GROUPING OF TIMBERS FOR STRUCTURAL USE

(Clauses 3.1, 4.1.1.1, 4.1.1.2 and 4.1.2)

HEARTWOOD NATURALLY
DURABLE

SPECIES FOR PERMANENT STRUCTURES

SPECIES FOR TEMPORARY
STRUCTURES OR SEMI-
STRUCTURAL USES

First Choice

Second Choice

Heartwood moderately durable with Class 'a', 'b' and 'c' treatability and of low durability with Class 'a' and 'b' treatability

Heartwood moderately durable but refractory to treatment, that is, of Class 'd' treatability (treatability can be Improved for small dimensioned stocks)

Moderately Durable or Low Durability Species Whose Heartwood is Very Refractory to Treatment or Species Whose Durability and/or Treatability is not Yet Known

1

2

3

4

Botanical Name Trade Name

Botanical Name Trade Name

Botanical Name Trade Name

Botanical Name Trade Name

GROUP A

<i>Acacia catechu</i>	Khair	<i>Manilota polyandra</i> (Syn. <i>Cynometra polyandra</i>)	Ping	<i>Grewia tiliifolia</i>	Dhaman (Madras)	<i>Acacia chundra</i> *	Red Kutch (Lal Khair)
<i>Albizia odoratissima</i>	Black siris (Kala siris)					<i>Bruguiera</i> spp.*	Bruguiera (Mangrove)
<i>Hopea utilis</i> (<i>Balanocarpus utilis</i>)	Karung						
<i>Hopea glabra</i> and <i>Hopea parviflora</i>	Hopea					<i>Sageraea elliptica</i> *	Chooi
<i>Mesua ferrea</i>	Mesua					<i>Stereospermum chelonoides</i> *	Padri (Madras)
<i>Mimusops littoralis</i>	Bullet-wood						
<i>Petrocarpus santalinus</i>	Red sanders*						

(Continued)

TABLE 1 GROUPING OF TIMBERS FOR STRUCTURAL USE — Contd

HEARTWOOD NATURALLY DURABLE

SPECIES FOR PERMANENT STRUCTURES

SPECIES FOR TEMPORARY STRUCTURES OR SEMI-STRUCTURAL USE

First Choice

Second Choice

Heartwood moderately durable with Class 'a', 'b' and 'c' treatability and of low durability with Class 'a' and 'b' treatability

Heartwood moderately durable but refractory to treatment, that is, of Class 'd' treatability (treatability can be improved for small dimensioned stocks)

Moderately Durable or Low Durability Species Whose Heartwood is Very Refractory to Treatment or Species Whose Durability and/or Treatability is not Yet Known

1		2		3		4	
Botanical Name	Trade Name	Botanical Name	Trade Name	Botanical Name	Trade Name	Botanical Name	Trade Name

Pocilonuron indicum

Ballagi

Shorea robusta

Sal
(Uttar Pradesh, West Bengal Bihar, Assam)

Vitex altissima

Milla

GROUP B

Albizia lebbek

Kokko

Acacia nilotica

Babul

Anogeissus latifolia

Dhaura
(Axle wood, Bakli)

Adina cordifolia
Cullenia rosay-roana

Haldu
Karani

Carallia lucida
Grewia vestita

Maniawga
Dhaman
(West Bengal)

*Acacia ferruginea**
Acrocarpus raxinifolius

Safed Khair
Mundani

Artocarpus hirsutus

Aini
(Madras)

(Syn. *C. rexcelso*)

*Adina Oligocephala** (Arunachal Pradesh)

*Aglaiia edulis** (Assam)

Aglaiia

Diploknema butyracea (*Bassia butyracea*)

Hill Mabua

Dipterocarpus Spp.

Gurjan

*Anogeissus Acuminata**

Yon

Cassia fistula

Amaltas

Dipterocarpus macrocarpus

Hollong

*Atalantia monophylla** (Orissa)

Jungli Nimbu

<i>Dysoxylum malabaricum</i>	White cedar	<i>Quercus lamellosa</i> <i>Schleichera</i> <i>Oleosa</i> (syn. <i>S. trijuga</i>)	Oak (West Bengal) Kusum (Bihar)	<i>Altingia excelsa</i>	Jutili
<i>Eucalyptus globulus</i> (Mad.)	Eucalyptus (Blue gum)	<i>Terminalia bellerica</i>	Bahera	<i>Amoora</i> spp.	Amari (West Bengal)
<i>Gluta travancorica</i>	Gluta	<i>Terminalia chebula</i>	Myrobalan (Harda)	<i>Canarium strictum</i> *	Dhup
<i>Hard-wickia pinnata</i> *	Piney	<i>Terminalia manii</i>	Black chuglam	<i>Cassia siamea</i> *	Kasod
<i>Heritiera</i> spp.	Sundri			<i>Casuarina equisetifolia</i>	Casuarina
<i>Kingiodendron pinnatum</i>	Anjan			<i>Calophyllum teomentosum</i>	Poon (Madras)
<i>Lagerstroemia lanceolata</i>	Benteak			<i>Castenopsis indica</i> *, (Meghalaya)	Chestnut
<i>Mimusops elengi</i>	Bakul, bullet wood (Madras)			<i>Chloroxylon swietenia</i> *	Satinwood
<i>Petrocarpus dalbergioides</i>	Padeuk			<i>Palaquium ellipticum</i> (Syn. <i>Dichopsis elliptica</i>)	Pali
<i>P. marsupium</i>	Bijasal (Maharashtra)			<i>Palaquium polyanthum</i> (Syn. <i>Dichopsis polyantha</i>)	Tali
<i>Shorea robusta</i>	Sal (Madhya Pradesh)			<i>Diospyros microphylla</i> * (Maharashtra)	Ebony
<i>Soymdia febrifuga</i>	Rohini (Madras)			<i>Diospyros pyrrocarpa</i> *	Ebony
<i>Tectona grandis</i>	Teak (Madras, West Bengal, Maharashtra and Uttar Pradesh)			<i>Dipterocarpus bourdillonii</i> * (Kerala)	Gurjan

(Continued)

TABLE 1 GROUPING OF TIMBERS FOR STRUCTURAL USE — Contd

HEARTWOOD NATURALLY DURABLE		SPECIES FOR PERMANENT STRUCTURES				SPECIES FOR TEMPORARY STRUCTURES OR SEMI-STRUCTURAL USE	
		First Choice		Second Choice			
		Heartwood moderately durable with Class 'a', 'b' and 'c' treatability and of low durability with Class 'a' and 'b' treatability		Heartwood moderately durable but refractory to treatment, that is, of Class 'd' treatability (treatability can be improved for small dimensioned stocks)		Moderately Durable or Low Durability Species Whose Heartwood is Very Refractory to Treatment or Species Whose Durability and/or Treatability is not Yet Known	
1		2		3		4	
Botanical Name	Trade Name	Botanical Name	Trade Name	Botanical Name	Trade Name	Botanical Name	Trade Name
<i>Terminalia parrieulata</i>	Kindal					<i>Eucalyptus citriodora</i> *	Eucalyptus
<i>Terminalia tomentosa</i>	Sain (Laurel)					<i>Eucalyptus eugenioides</i>	Eucalyptus (Madras)
<i>Xylia xylocarpa</i>	Irul					<i>E. tereticornis</i> * (Tamil Nadu)	
<i>Zanthoxylum</i> spp.	Mullilam					<i>Exbucklandia populnea</i> *	Pipli
						(Syn. <i>Bucklandia populnea</i>)	Pipli (West Bengal)
						<i>Franxinus</i>	Ash
						<i>Lagerstroemia parviflora</i>	Lendi
						<i>Machilus odoratissima</i>	Machilus (West Bengal)
						<i>Mesua assamica</i> *	Sianohor (Kayea)
						<i>Mesua floribunda</i> (Syn. <i>Kayea</i>)	Karol

∞

- Morus laevigata** Bola (Assam)
*Planchonia valida** Red bombwe
 (Syn. *P. andamanica*)
*Pometia Pinnata**
 (Andaman)
Quercus griffithii Oak
 (Meghalaya)
*Miliusa tomentosa** Hoom
 (Syn. *Saccopetalum tomentosum*)
*Shorea talura**
 (Maharashtra)
Pterygota alata Narikel
 (Syn. *sterculia alata*)
Syzygium spp. Jaman
Terminalia bialta White chuglam
*Terminalia citrina**
 (Assam)
*Thespesia populnea** Bhendi
 (Maharashtra)

GROUP C

- | | | | | | | |
|----------------------------|--------------------------------|---|-------|-----------------------------|----------|--|
| <i>Albizia procera</i> | White siris
(Safed siris) | <i>Adina cordifolia</i> | Haldu | <i>Artocarpus chaplasha</i> | Chaplash | <i>Acacia leucophloea</i> * Hiwar
(Madhya Pradesh) |
| <i>Artocarpus lakoocha</i> | Lakooch | <i>Anthocephalus chinensis</i> (Syn. <i>A. cadamba</i>) | Kadam | | | <i>Acacia melanoxylon</i> * Black wood
(Madras)
<i>Acacia mearnsii</i> * Black wattle
(Syn. <i>A. mollissima</i>)
(Madras) |

(Continued)

TABLE 1 GROUPING OF TIMBERS FOR STRUCTURAL USE — Contd

HEARTWOOD NATURALLY DURABLE

SPECIES FOR PERMANENT STRUCTURES

SPECIES FOR TEMPORARY STRUCTURES OR SEMI-STRUCTURAL USES

First Choice

Second Choice

Heartwood moderately durable with Class 'a', 'b' and 'c' treatability and of low durability with Class 'a' and 'b' treatability

Heartwood moderately durable but refractory to treatment, that is, of Class 'd' treatability (treatability can be improved for small dimensioned stocks)

Moderately Durable or Low Durability Species Whose Heartwood is Very Refractory to Treatment or Species Whose Durability and/or Treatability is not Yet Known

1

2

3

4

1		2		3		4	
Botanical Name	Trade Name	Botanical Name	Trade Name	Botanical Name	Trade Name	Botanical Name	Trade Name
<i>Artocarpus heterophyllum</i> (Syn. <i>A. Integrifolia</i>)	Jack, Kathal	<i>Castanopsis hystrix</i>	Indian chestnut (West Bengal)			<i>Acer spp.</i>	Maple
<i>Madhuca longifolia</i> var <i>latifolia</i> (Syn. <i>Bassia latifolia</i>)	Mahua	<i>Toona ciliata</i>	Toon			<i>Aegle marmelos</i>	Bael
<i>Aphanamixis polystachya</i> (<i>Amoora rohituka</i>)	Pitraj	<i>Chukrasia velutina</i> (<i>C. tabularis</i>)	Chickrassy			<i>Aesculus indica</i>	Horse chestnut (Uttar Pradesh)
		<i>Dillenia pentaegyna indica</i>	Dillenia			<i>Ailanthus integrifolia</i> *	Gokul
		<i>Holoptelea integrifolia</i>	Kanju			<i>Anogeissus pendula</i>	Kardhai
<i>Boswellia serrata</i>	Salai	<i>Mangifera indica</i>	Mango, sam			<i>Areca nut</i> * (Kerala)	Supari
<i>Bridelia retusa</i>	Kassi					<i>Albizia lucida</i> * (Arunachal, Andhra Pradesh)	—
		<i>Mitragyna parvifolia</i> (Syn. <i>Stephogyne parvifolia</i>)	Kaim			<i>Azadirachta indica</i>	
						<i>Betula alnoides</i> *	Birch
						<i>Bischofia</i>	Uriam

<i>Careya arborea</i>	Kumbi	<i>Phoebe goalparensis</i> (<i>P. goalparensis</i>)	Bonsum	<i>Javanica</i> (Bishop wood) <i>Borassus flabel- lifer</i> (Tad (Palm) (Andhra Pradesh)
<i>Cedrus deodara</i>	Deodar	<i>Pinus roxburghii</i> (Syn. <i>P. longifolia</i>)	Chir	<i>Bursera serrata</i> Muntenga (Syn. <i>Protium serratum</i>)
<i>Cupressus toru- losa</i>	Cypress	<i>Pinus wallichiana</i>	Kail	<i>Callitris rhomboidea</i> (Syn. <i>Frenela rhomboidea</i>)
<i>Dalbergia latifolia</i>	Indian rosewood	<i>Quercus</i> spp.	Oak (Nefa)	<i>Calophyllum teomentosum</i> Poone
<i>Dalbergia sissoo</i>	Sissoo	<i>Terminalia arjuna</i>	Arjun	<i>Canarium strictum Roxb*</i> Dhuna (Assam) (White Dhup)
<i>Garuga pinnata</i>	Garuga	<i>Terminalia myriocarpa</i>	White hollock	<i>Chlorophora excelsa*</i> (Madras) Coconut
<i>Gmelina arborea</i>	Gamari	<i>Terminalia procera</i>	White bombwe	<i>Cocos nucifera</i> (Kerala)
<i>Hardwickia pinnate</i>	Piney			<i>Dillenia pentagyna</i> Dillenia <i>Diospyros melanoxylon</i> Ebony <i>Duabanga grandiflora</i> Lampati (Syn. <i>Sonneratioides</i>)
<i>Michelia montana</i>	Champ (West Bengal)			
<i>Ougeinia oojeinen- sis</i> (Syn. <i>O. dalbergioides</i>)	Sandan			<i>Elaeocarpus tuber- culatus</i> Rudrakshi (Rudrak)
<i>Petrocarpus marsupium</i>	Bijasal (Bihar)			<i>Eucalyptus hybrid*</i> Mysore-gum (Tamil Nadu, Karnataka and Gujarat)
<i>Tectona grandis</i>	Teak (Madhya Pradesh, Orissa)			<i>Eucalyptus camal- dulensis*</i> Eucalyptus (Karnataka, Uttar Pradesh)
				<i>E. pilularia*</i> Eucalyptus (Tamil Nadu)

(Continued)

TABLE 1 GROUPING OF TIMBERS FOR STRUCTURAL USE — *Contd*

HEARTWOOD NATURALLY DURABLE		SPECIES FOR PERMANENT STRUCTURES				SPECIES FOR TEMPORARY STRUCTURES OR SEMI-STRUCTURAL USE	
		First Choice		Second Choice			
		Heartwood moderately durable with Class 'a', 'b' and 'c' treatability and of low durability with Class 'a' and 'b' treatability		Heartwood moderately durable but refractory to treatment, that is, of Class 'd' treatability (treatability can be improved for small dimensioned stocks)		Moderately Durable or Low Durability Species Whose Heartwood is Very Refractory to Treatment or Species Whose Durability and/or Treatability is not Yet Known	
1		2		3		4	
Botanical Name	Trade Name	Botanical Name	Trade Name	Botanical Name	Trade Name	Botanical Name	Trade Name
						<i>E. propinus</i> *	Eucalyptus (Tamil Nadu)
						<i>E. saligna</i> *	Eucalyptus (Uttar Pradesh)
						<i>Gardenia latifolia</i> *	Gardenia (Madhya Pradesh)
						<i>Heterophragma roxburghii</i>	Palang
						<i>Intsia bijuga</i> (Syn.	
						<i>Azalia bijuga</i>)	
						<i>Juglans</i> spp.	Walnut
						<i>Lagerstroemia speciosa</i>	Jarul
						(Syn. <i>L. flosreginae</i> Retz.)	
						<i>Lannea coromandelica</i>	Jhingan
						(Syn. <i>L. grandis</i>) (Uttar Pradesh)	
						<i>Lophopetalum wightianum</i>	Banati
						<i>Leucaena leucocephala</i> *	Subabul†
						(Uttar Pradesh)	
						<i>Machilus macrantha</i>	Machilus
						<i>Michelia excelsa</i>	Champ

<i>Mallotus philippensis</i>	Raini
<i>Manglietia</i> spp. (Assam)	
<i>Melia indica</i> *	Neem
<i>Miliusa velutina</i>	Domsal
<i>Morus alba</i>	Mulberry
<i>Morus serrata</i>	Toolii
<i>Parrotiopsis jacou-</i> <i>montiana</i>	Pohu (Parrotia)
<i>Pinus kesia</i> (Syn. <i>Pinus insularis</i>)	Khasi Pine
<i>Pistacia integerrima</i> (J & K)	Klakar singhi
<i>Podocarpus nerrifolius</i>	Thitmin
<i>Polyalthia fragrans</i>	Debdaru (Nedunar)
<i>Prunus napaulensis</i>	Arupati (West Bengal)
<i>Pterospermum acerii-</i> <i>folium</i>	Hathipaila
<i>Radermachera xylo-</i> <i>carpa</i> (Syn. <i>Stereo-</i> <i>spermum xylocarpum</i>)	Vedankonnai (Madras)
<i>Schima wallichii</i>	Chilauni
<i>Shorea assamica</i>	Makai
<i>Sonneratia apetala</i>	Makai
<i>Stereospermum chelo-</i> <i>noides</i> (Syn. <i>S.</i> <i>suaveolans</i>)	Padriwood (West Bengal, Uttar Pradesh)
<i>Taxus baccata</i> *	Yew
(West Bengal)	
<i>Tamarindus indica</i> *	Imli
<i>Vateria indica</i>	Vellapine

NOTE — Such species may be used for permanent type of structures provided there is otherwise enough local evidence of their durability by past usages/experience.

*Indicates the inadequacy of available data on durability and/or treatability for choice classification.

†Based on strength properties at three years age of tree.

3.1.3 Based on permissible defects, cut sizes of structural timbers are classified in three grades, namely, select grade, Grade I and Grade II (see IS : 1331-1971*, wherein they have been named as Grade 1, Grade 2 and Grade 3 respectively. These grades have also been referred to as select, standard and common grade in some publications). Last category after Grade II, materials may be structural rejects, not suitable for structural members.

3.2 Moisture Content in Timber

3.2.1 Seasoning is an integral part of timber utilization. For classification of timbers for seasoning purposes, preliminary treatment and storage, seasoning methods, kiln schedules for drying different species of timbers, kiln operation procedure, etc, reference may be made to IS : 1141-1973†.

3.2.2 Unless otherwise specified, the moisture content of timber for various situations of buildings in different climatic zones of the country shall conform to the requirement of IS : 287-1973‡.

3.3 Treatment and Protection of Timber

3.3.1 Durability — For durability the timbers are classified into the following three classes according to their average life in 'grave yard' (see Note below) tests:

- a) Class I Natural durable heartwood timbers having average life of 120 months and over (high durability),
- b) Class II Natural durable heartwood timber having average life of 60 months and over but less than 120 months (moderate durability), and
- c) Class III Timbers having average life less than 60 months (low durability).

The average life will be more than indicated above in case of structural members above ground.

NOTE — Durability of various species is indicated in IS : 401-1982§. Durability of various species in their heartwood is based on the 'Grave Yard' tests carried out in the open in which test specimens of sizes 50 × 50 × 600 mm and/or 38 × 38 × 305 mm of untreated heartwood were buried in the ground to half their length.

*Specification for cut sizes of timber (second revision).

†Code of practice for seasoning of timber (first revision).

‡Recommendations for maximum permissible moisture content for timber used for different purposes (second revision).

§Code of practice for preservation of timber (third revision).

3.3.1.1 In a timber structure using heartwood of secondary species, if one end of the timber column or post is buried in the ground, it will last only for a limited period. But for prolonged service life of a structure well over say 30 years, and to guard against deteriorating agents and other adverse factors, the timber column or post shall not be embedded in the ground but kept well above the floor level.

3.3.2 Preservation — Preservative treatment of timber forms a very important part of the national effort in conserving material resources and their most economic utilization. Before use in permanent structures, species of the following types of timber shall be chemically treated for protection against deterioration due to attack by fungi and termites, borers and marine organism, etc, in accordance with IS : 401-1982*:

- a) Heartwood of all species of timber of moderate and low durability;
- b) Heartwood of all species of timber of high durability containing more than 15 percent sapwood; and
- c) Sapwood of all species of timber of any class or durability.

3.3.2.1 Heartwood of all species of timber of high durability do not require preservative treatment except in cases coming under (b) above.

3.3.3 Treatability — Treatable timbers may be classified as follows to indicate approximately the degree of resistance offered by the heartwood of a species to the penetration of the preservative solution under a hydraulic pressure of 1.05 N/mm^2 . The treatability of the heartwood of different species is indicated in 5 grades, each grade being defined as under:

- a) Class a Heartwood easily treatable;
- b) Class b Heartwood treatable but complete penetration of preservative not always obtained, in case when least dimension is more than 60 mm;
- c) Class c Heartwood only partially treatable;
- d) Class d Heartwood refractory to treatment; and
- e) Class e Heartwood very refractory to treatment, penetration of preservative being practically nil even from the end.

*Code of practice for preservation of timber (*third revision*).

4. SUITABILITY AND GROUPING

4.1 The suitability of structural timber for a given purpose depends upon the following:

- a) Durability and treatability of the species;
- b) Strength characteristics of the species; and
- c) Grading in respect of freedom from defects.

4.1.1 *Suitability in Respect of Durability and Treatability for Permanent Structures* — There are two choices and they are given below.

4.1.1.1 *First choice* — The species shall be of any one of the following categories:

- a) Untreated heartwood of high durability as listed in Table 1. Heartwood of these species of timber, if containing more than 15 percent sapwood, needs treatment for protection.
- b) Treated heartwood of moderate and low durability and Class 'a' and Class 'b' treatability (to obtain maximum penetration and absorption of preservative) as listed in Table 1.
- c) Heartwood of moderate durability and Class 'c' treatability after pressure impregnation (to obtain maximum penetration and absorption of preservative) as listed in Table 1.
- d) Sapwood of all classes of durability after thorough treatment with preservatives.

NOTE — All such species which can be adequately treated to desired retention of preservative may be used.

4.1.1.2 *Second choice* — The species shall be of heartwood of moderate durability and Class 'd' treatability. Small thicknesses up to 60 mm when treated under pressure impregnation, shall be used for components under cover and out of contact with ground, for example, for roof trusses, columns, beams, lamella arches, solid web type girders using small dimensioned timber fabricated through engineered timber techniques for residential buildings, industrial sheds, etc. Such timbers are listed in col 3 of Table 1.

4.1.2 *Suitability in Respect of Durability and Treatability for Temporary Structures and for Semi-Structural Uses* — Heartwood of low durability and Class 'e' treatability or the species whose durability and/or treatability is yet to be established may be used where life of the structure is not primary consideration. Such timbers are listed in col 4 of Table 1.

4.2 Grouping — Species of timber recommended for constructional purposes are classified in three groups on the basis of their strength properties, namely, modulus of elasticity (*E*) and extreme fibre stress in

bending and tension along grain (f_t). The characteristics of these groups for Grade I structural material are as follows:

Groups	Modulus of Elasticity (E) N/mm ²	Limit (f_t) N/mm ²
A	Above 12 600	18.0
B	Above 9 800 and up to 12 600	12.0
C	Above 5 600 and up to 9 800	8.5

NOTE — These groups were earlier referred to as super, standard and ordinary. Generally timbers above 0.65 specific gravity fall under Group A, between 0.50 and 0.65 fall under Group B and those below 0.50 fall under the Group C.

5. PERMISSIBLE STRESSES

5.1 Basic stress values of different groups of timber are determined on small clear specimen according to standard practice (IS : 1708-1969*). These values are then divided by the appropriate factors of safety (as given in Table 2) to obtain the permissible stresses.

TABLE 2 FACTORS OF SAFETY TO BE APPLIED TO BASIC STRESS TO OBTAIN SAFE PERMISSIBLE STRESS

Sl. No.	TYPES OF STRESS	GRADE I (STANDARD) LOCATION		
		Inside	Outside	Wet
(1)	(2)	(3)	(4)	(5)
i)	Extreme fibre stress in beams for broad leaved species, <i>Min</i>	5	6	7.5
ii)	Extreme fibre stress for beams in conifers, <i>Min</i>	6	7	8.5
iii)	Shear along grain	7	7	7
iv)	Horizontal shear in beams	10	10	10
v)	Compressive stress parallel to grain, <i>Min</i>	4	4.5	5.5
vi)	Compressive stress perpendicular to grain	1.75	2.25	2.75

5.2 The values of permissible stresses for Groups A, B and C species appropriate to location of use and applicable to Grade I structural timber shall be as given in Tables 2 and 4 of IS : 883-1970† provided that the following conditions are satisfied:

- a) The timbers should be of high or moderate durability and be given suitable treatment where necessary. They may be

*Methods of testing small clear specimens of timber (*first revision*).

†Code of practice for design of structural timber in building (*third revision*).

used on any location. If the location is inside and not in contact with the ground, low durability timber may be used after proper seasoning and preservative treatment.

- b) The loads should be continuous and permanent and not impact type.

5.3 For other grades the permissible stresses given in Tables 2 and 4 of IS : 883-1970* shall be multiplied by the following factors to obtain the permissible stresses assuming that the conditions laid down in 5.2 are satisfied:

- | | |
|----------------------------|------|
| a) For select grade timber | 1.16 |
| b) For Grade II timber | 0.84 |

5.3.1 When low durability timbers are to be used on outside locations, the permissible stresses for all grades of timber, arrived at by 5.2 and 5.3 shall be multiplied by 0.8.

5.3.2 When the timber has not been graded and has certain slope of grain the working stresses shall be as given in Table 3.

TABLE 3 ALLOWABLE PERCENTAGE STRENGTH FOR SLOPE IN GRAIN

SLOPE	STRENGTH OF BEAMS JOISTS AND TIES <i>Max</i> percent	STRENGTH OF POSTS OR COLUMNS <i>Max</i> percent
(1)	(2)	(3)
1 in 10	61	74
1 in 12	69	82
1 in 14	74	87
1 in 15	76	100
1 in 16	85	100
1 in 18	85	100
1 in 20	100	100

5.4 Shocks Under Impact — Under impact, wood shall be considered as capable of resisting a force twice that of the static load for which it has been designed.

*Code of practice for design of structural timber in building (*third revision*).

6. DIMENSIONS AND TOLERANCES

6.1 Sawn Timber — The cut sizes of timber for structural purpose and the tolerances shall be those as given in IS : 4891-1968*, except where no dimensions are specifically mentioned. Permissible tolerances in measurements shall be as follows:

- | | |
|---|-------------------|
| a) For measurements up to and including
100 mm in width or thickness | — 0 mm
+ 3 mm |
| b) For measurements above 100 mm
in width or thickness | — 3 mm
+ 6 mm |
| c) For measurements of all sizes in
length | — 0 mm
+ 10 mm |

7. FACTORS AFFECTING STRENGTH OF TIMBER

7.1 Prohibited Defects — All grades of timber with the following defects shall be prohibited for structural use:

- a) Timber with loose grain, splits, compression wood in coniferous structural timber, heartwood rot and sap rot and crookedness.
- b) Worm holes made by powder post beetles and pitch pockets.

7.2 Permissible Defects — The following defects are permissible for all grades of timber:

- a) Wanes are permitted provided they are not combined with knots and the reduction in strength on account of the wanes is not more than the reduction with the maximum allowable knots. Wanes may also be permitted provided there is no objection to its use as bearing area, nailing edge and affects general appearance;
- b) Worm holes other than those due to powder post beetles located and grouped to reduce the strength of timber shall be evaluated in the same way as knots; and
- c) All other defects which do not affect any of the mechanical properties of timber shall be permitted.

7.3 Other Injurious Defects in Timber — The significance of defects like knots, checks and shakes in timber and their strength reducing parameters are given in 8.

7.4 Closeness of Grain (Rate of Growth) — As far as possible, closeness of grain shall preferably be not less than 12 rings per 50 mm. Where it is not possible to observe closeness of grains these provisions will not apply. No allowance for changes in moisture content is necessary for structural timber in normal circumstances.

*Specification for preferred cut sizes of structural timbers.

7.4.1 Unit Weight — Timber having average unit weight less than 75 percent of the values given in Table 1 of IS : 883-1970* shall not be permitted for use for structural purposes.

7.5 Sapwood — For consideration of strength no distinction shall be made between heartwood and sapwood. While heartwood is more resistant to decay, sapwood, has low resistant but can be improved after preservative treatment.

7.5.1 Sapwood more than 15 percent in heartwood timber of high and moderate durability shall not be allowed in permanent structures unless it is thoroughly impregnated with wood preservatives. The heartwood of all non-durable timbers shall be properly treated with preservatives for permanent structures.

7.6 Pith — Presence of pith shall not be considered as a defect to reduce the strength but checks, shakes and softness in the pith as compared to the neighbouring portions adversely affect strength and so shall be duly taken into consideration.

7.7 Live and Dead Trees — Timber from dead trees, provided they are totally free from decay, cross checks and insect attack, shall be considered to have the same strength as timber from a living tree of corresponding moisture content.

7.8 Moisture Content — Strength of timber is considerably influenced by moisture content. It will generally decrease from oven-dry condition to fibre-saturation point and thereafter, will not appreciably change for any increase of moisture content. For seasoned timber having minimum thickness below 100 mm and moisture content not more than 18 percent, an increase of 20 percent in strength values listed in Table 2 of IS : 883-1970* may be allowed for bending and compression members for inside location only.

7.8.1 Air-dried and Kiln-dried Timber — For purposes of design no distinction shall be made between the strength of air-dried timber and kiln-dried timber, unless it has developed drying defects, such as case hardening owing to drastic drying conditions developed in the kiln-dried timber.

7.9 Treatment — Wood preservatives and fire retardants shall not be considered to impair the strength of wood except in the case of some treating process at high temperatures. In the latter case, due allowance for the loss of strength shall be made in the design. With increasing temperature, the strength of timber decreases; but at the temperature to which structural timbers are normally exposed, serious permanent effects are unlikely.

*Code of practice for design of structural timber building (*third revision*).

8. INFLUENCE OF DEFECTS ON STRUCTURAL TIMBER AND DATA REGARDING ALLOWANCE IN STRENGTH

8.1 Being a biological product of nature, timber is not uniform in its characteristics. A completely defect-free timber, though desirable will rarely be available for structural use. The data is intended to provide guidance regarding reduction parameters in the strength, where defects of various kinds are present in structural timber. Precautionary measures to be taken into account during the selection, conversion, design and fabrication stages of timber are also included to reduce the extent of influence of defects. For identification and measurements of defects, reference may be made to IS : 3364 (Part 2)-1976*.

8.2 Allowance of Defects

8.2.1 Slope of Grain (Cross Grain) — (see Fig. 1).

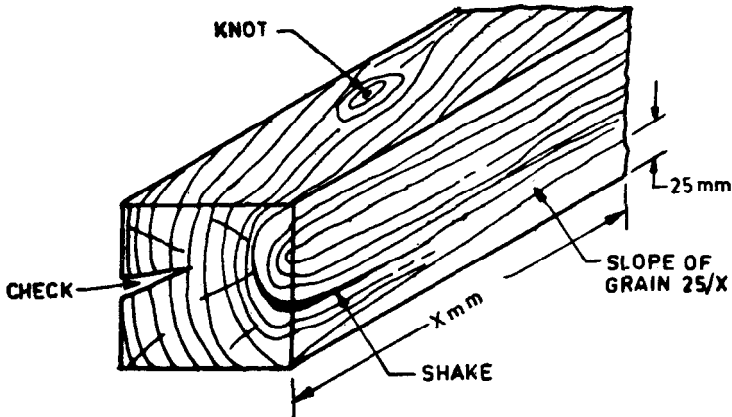


FIG. 1 KNOTS, CHECKS, SHAKES, AND SLOPE OF GRAINS

8.2.1.1 Significance — Wood offers much greater resistance to load parallel to the direction of fibres than across. If there is slope of grain with reference to longitudinal axis, allowance for reduction of strength shall be made as given in Table 3.

8.2.1.2 Permissible values — The maximum limits for sloping grain will be as given below:

1 in 20	For select grade
1 in 15	For Grade I
1 in 12	For Grade II

*Methods of measurements and evaluation of defects in timber: Part 2 Converted timber (first revision).

8.2.1.3 Method of allowance — For various values of slope of grain and also for different situations of use, the allowable strength for timber for sloping grains as a percentage of the permissible values for perfectly straight grained timber without defects will be as specified in Table 3.

8.2.2 Knots

8.2.2.1 Significance — When a limb or branch takes off from the trunk of a tree, there will be continuous growth, at the junction of the branch and the trunk, when the branch is cut away the section of the cut away portion on the trunk, is called a knot. A knot is, therefore, a distortion or deviation of the fibres which invariably depreciates the strength of timber.

During the process of seasoning the timber, checks (that is splits) are likely to develop in and around the knotty portion of the wood, thus causing further seasoning degrades (see Fig. 2). The strength reducing effects of knots are more pronounced on tensile strength of timber, compared to those on compression and shear. The effect of knots on the stiffness of a beam is very small. Thus, deflection is not affected to an appreciable degree by knots.

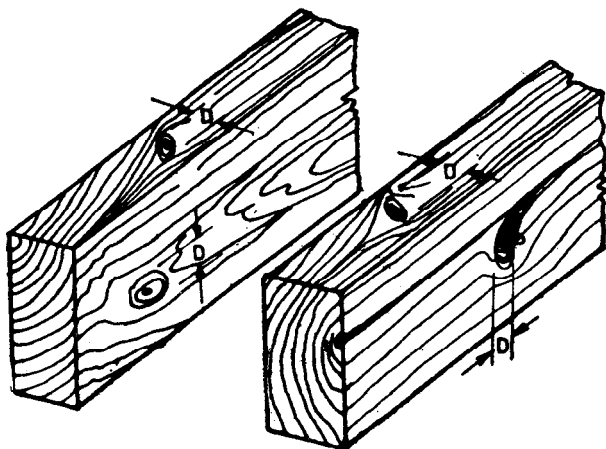


FIG. 2 MEASUREMENT OF KNOTS IN BEAMS

8.2.2.2 Permissible values — The permissible sizes of knots would depend upon the size and grade of the structural timber and shall be in accordance with the relevant provisions of IS : 1331-1971*, as given in Table 4.

*Specification for cut sizes of timber (second revision).

**TABLE 4 MAXIMUM ALLOWABLE DEFECTS FOR GRADE I
(STANDARD) WOOD**

(Clause 8.2.2.3)

All dimensions in millimetres.

WIDTH OF FACE	SIZE OF KNOTS <i>D</i> , Max (see FIG. 2)		CROSS* GRAIN MAXIMUM SLOPE
	Narrow Face and $\frac{1}{2}$ of the Width of Wide Face Close to Top and Bottom Edges	The Remaining Central Half of the Width of the Wide Face	
(1)	(2)	(3)	(4)
75	19	19	} 1 in 15
100	25	25	
150	38	38	
200	44	50	
250	50	57	
300	54	75	
350	57	81	
400	63	87	
450	66	93	
500	69	100	
550	72	103	
600	75	106	

*The angle of grain shall be measured by the deviation of fibres from the edge of the timber and shall not exceed 1 in 15 in the Grade I timber.

8.2.2.3 Method of allowance — No knot beyond permissible sizes should occur in beams, joists and other members in bending as shown in Fig. 3 and 4. If the sizes of knots present are not more than half as large as those provided in Table 4, increase in permissible stress to 7/6 times over those for Grade I may be permitted. However, if the sizes of knots are larger than those provided in Table 4, but in no case exceeding $1\frac{1}{2}$ times than those sizes, the permissible stress shall be reduced to 5/6 times the values for Grade I.

8.2.3 Checks (see Fig. 1) and Shakes (see Fig. 5)

8.2.3.1 Significance — Checks and shakes refer to cracks of timber due to defects in growth or seasoning. Presence of checks and shakes will reduce the resistance to shear considerably and will also give access to moisture entry; they are more serious in the case of bending members than in directly stressed members.

8.2.3.2 Method of allowance — Shakes and checks are generally measured at the ends of timber piece. Size of the shake is the distance between lines enclosing the shake and parallel to wide faces of the piece. The width of shake shall be taken as the length of its vertical projections measured on either end of timber. In beams, joists and planks, only

middle half portion is considered for measurement. In seasoned material of Grade I (standard) timber, shake is permitted at the end to the extent of about $1/3$ of the width of timber piece. This is also applicable to checks measured appropriately. The size of checks is taken within the middle half of the height of the piece and within a distance of three times the height from the end.

When checks on two parallel faces are opposite to each other, the sum of their sizes is taken for measurement. The sum of the sizes of shakes and checks should not exceed the permissible sizes of shakes. If the sizes of checks and shakes are greater or lesser than those corresponding to Grade I, the allowance for increased or decreased values of permissible stresses shall be made in the same manner as for knots.


8.3 Measures to Minimize the Effects of Defects on Structural Timber — The precaution to be observed in the conversion, design, fabrication and erection stages shall be as covered in 8.3.1 to 8.3.4. These precautions at the same time will facilitate all the tolerable defects in timber consistent with economy and conservation of material.

8.3.1 Conversion of Logs into Structural Timber

8.3.1.1 While converting it may be ensured that the slope of grain is as minimum as possible preferably not exceeding 1 : 15. Edge-grain scantlings (see Fig. 6) provide better structural members. Tangentially cut scantlings, preferably those which have slope of grain less than 1 : 15 shall be used.


8.3.1.2 The sizes of members and the portions of the log from which they are cut shall be suitably adjusted to reduce the adverse effects of knots, checks and shakes (see 8.2.2 and 8.2.3).

NOTE — Considering the effect of differential shrinkage of timber when subjected to moisture variation, the structural timber obtained from various portions of the log may be selected for various types of structural use as shown in Fig. 7.

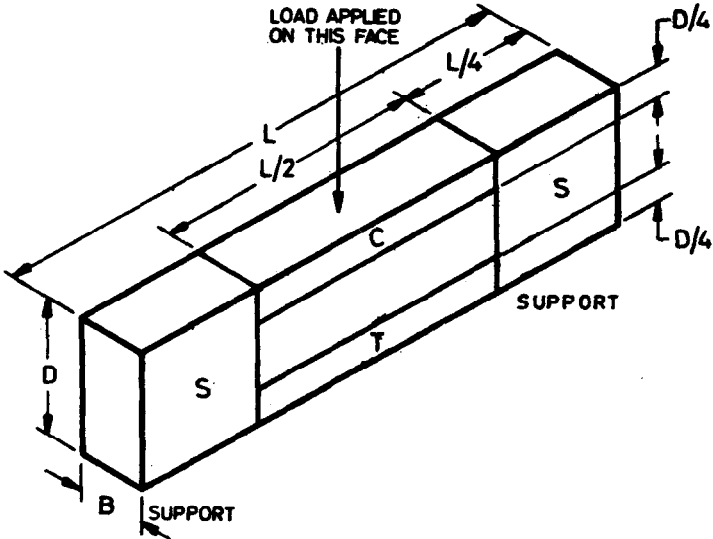

Zone of critical tension (*T*), compression (*C*), and shear (*S*). The allowable sizes, numbers, etc., of the strength reducing defects such as knots, for any particular grade of timber, are generally worked out with respect to these zones.

FIG. 3 SKETCH OF BEAM SHOWING CRITICAL ZONES

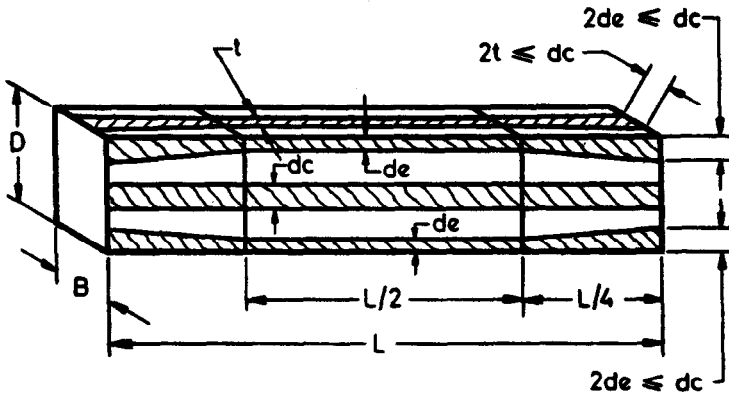


dc = Maximum size of the allowable knot in centre line of the wider face (allowable size to be determined by grading rules).


de = Maximum size of the allowable knot in the edges of the wider face.

t = Maximum size of the allowable knot in the middle half length of the beam on its narrow face.

FIG. 4 ALLOWABLE SIZES OF KNOT IN THE DIFFERENT REGIONS OF NARROW AND WIDER FACES OF A BEAM

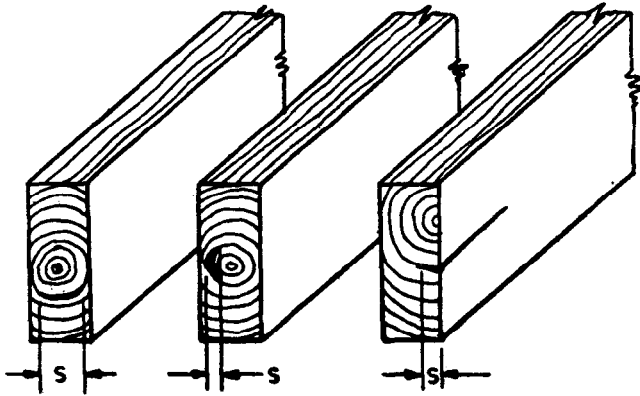

5A Measurement of Shakes in Beams, Joists and Planks

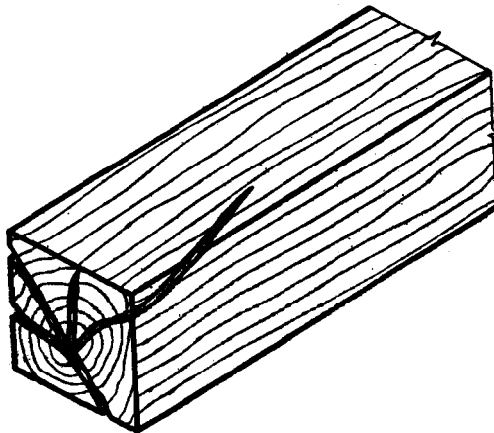

5B Star Shake

FIG. 5 SHAKES


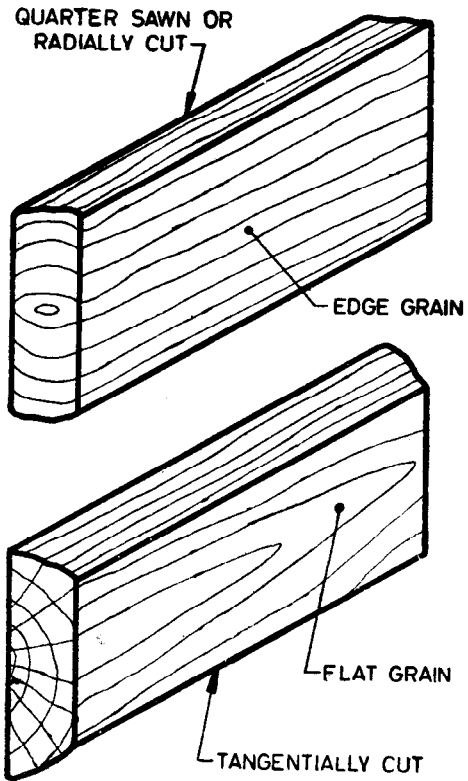


FIG. 6 FLAT AND EDGE GRAIN TIMBER

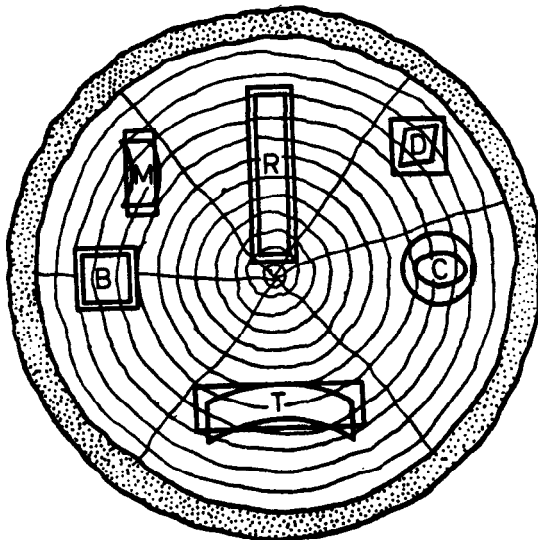

- R — Best for dowel and planks (structural).
- T — Not good for structural planks.
- M — Intermediate between 'R' and 'T'.
- B — Best for joists and beams.
- D — Discarded for joists and beams.
- C — Showing circular shrinkage.

NOTE — The outer lines indicate the shape and size of various pieces in green condition and the inner ones after shrinkage on drying.

FIG. 7 SKETCH SHOWING DIFFERENTIAL SHRINKAGE IN THE TANGENTIAL AND RADIAL DIRECTIONS

8.3.1.3 Long logs may be cut into shorter length before conversion into structural timber to avoid severe slope of grain if anticipated.

8.3.2 Design Stage — While selecting timber, preferably locally available species shall be specified only (see IS : 399-1963*). The selection should not be restricted to durable timber but also to timbers which give satisfactory service after proper treatment and seasoning.

8.3.2.1 While specifying the actual size for structural members, the following points may also be considered:

- a) Generally thinner sizes of timber are easier to seasoning;
- b) In choosing timber planks it may be noted that wider the section the more it is liable to warp and twist; and

*Classification of commercial timbers and their zonal distribution (revised).

- c) Where small dimensional timber is used, consider nail-jointed timber construction in accordance with IS : 2366-1983*.

8.3.3 Fabrication Stage

8.3.3.1 Members shall be so arranged that serious knots; shakes and checks do not occupy regions of maximum stress intensities.

8.3.3.2 Knots, shakes and checks shall not occur where joints are to be provided.

8.3.3.3 Out of available timber stock the best pieces shall be used for tension and flexural members because the adverse effects of natural defects on compression members are not as severe as those on flexural and tension members.

8.3.3.4 In nailed and glued timber beams where outer laminations experience greater tension and compression than the inner layers nearer to neutral axis, sound pieces with lesser defects shall be used.

8.3.4 Erection Stage

8.3.4.1 The engineer shall check up the general arrangement of members and satisfy himself before the structure is erected in position, that is, beams, joists, trusses, etc, because even after a careful selection of the pieces, if a mistake is made during fixing the member in position, its strength properties may be adversely affected. For instance severe knots, which according to the designer should occupy the 'compression regions' only may occupy the 'tension zone' if the beam is just kept upside down (see Fig. 3). Such erection mistakes which may be due to inadequate or lack of proper engineering supervision need careful observation.

8.3.4.2 Development of stresses during erection (not provided for by designer) shall be minimized by careful handling of timber units.

9. STORING OF TIMBER

9.1 After selection and prior to fabrication and/or erection all structural timber shall be stored so as to prevent decay and renewed development of defect. A recommended practice for storing timber is given in **9.1.1** and **9.1.2**.

9.1.1 All timbers shall be piled into stacks upon well treated and even-surfaced beams, sleepers or brick pillars so as to be above the ground level by at least 150 mm. The various members shall be stored depending on their lengths, and material of equal lengths shall be piled together in layers with wooden battens called crossers separating one layer from another. The crossers shall be of sound wood, straight and uniform in thickness. In cases where separate crossers are not available smaller sections of the available structural timber may be used in their

*Code of practice for nail-jointed timber construction (first revision).

place. In any layer, an air space about 25 mm shall be provided between adjacent members. The longer pieces shall be placed in the bottom layers and shorter pieces in the top layers but one end of the stack shall be in a true vertical plane. The crossers in the different layers shall be in vertical alignment. The most suitable width and height of stack are recommended to be about 1.5 and 2.0 m. Distance between adjacent stacks is recommended to be at least 300 mm. A side view of such a stack is shown in Fig. 8. In case the stacking with the help of battens is not possible, the timber may be close-piled in heaps on raised foundations with the precautions specified above.

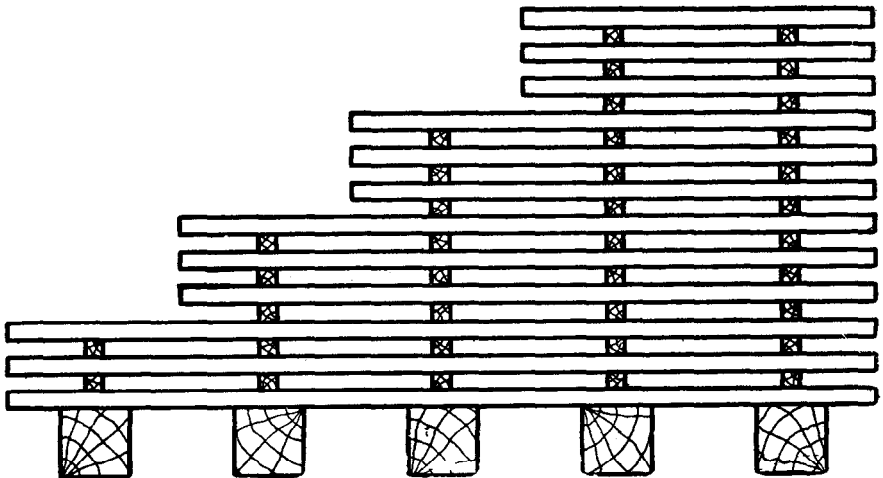


FIG. 8 TIMBER STACK

9.1.2 The stack shall be protected from hot dry winds or direct sun and rain. A sloping roof made of rejected planks may be used to drain off the rain water. Decayed or insect attacked planks should not be used. Heavy weights, such as metal rails or large section of wood, are recommended to be placed on the top of the stack to prevent distortion or warping the timber in the stack. To prevent end-cracking in the material the ends of all members shall be coated with thick coal tar, aluminium lead paint (hardened gloss oil) or any other suitable material as specified in IS : 1141-1973*.

9.1.3 As far as possible, seasoned timber should be promptly used before its moisture content gets time to alter due to climatic changes. However, when storage becomes unavoidable, it should be stored in close stacks under a shed maintained under dry conditions to retard moisture content changes.

*Code of practice for seasoning of timber (first revision).

(Continued from page 2)

<i>Members</i>	<i>Representing</i>
DEPUTY DIRECTOR STANDARDS (B&S)	Railway Board (Ministry of Railways)
ASSISTANT DIRECTOR (B&S)	(<i>Alternate</i>)
DIRECTOR	Indian Plywood Industries Research Institute, Bangalore
DR H. N. JAGADEESH	(<i>Alternate</i>)
DR C. D. DWIVEDI	Research & Development Organization (R & D) (Ministry of Defence)
SHRI R. A. PANSE	(<i>Alternate</i>)
SHRI P. N. GADI	Institution of Surveyors, New Delhi
SHRI J. SEN GUPTA	National Buildings Organization (Ministry of Works & Housing), New Delhi
SHRI A. K. LAL	(<i>Alternate</i>)
SHRI G. K. MAJUMDAR	Hindustan Prefab Ltd, New Delhi
SHRI H. S. PASRIOHA	(<i>Alternate</i>)
SHRI H. N. MISHRA	Forest Research Institute and Colleges, Dehra Dun
SHRI K. S. PRUTHI	(<i>Alternate</i>)
SUPERINTENDING SURVEYOR OF WORKS (CZ)	Central Public Works Department (Architecture Wing), New Delhi
SURVEYOR OF WORKS (CZ)	(<i>Alternate</i>)
SUPERINTENDING ENGINEER (PLANNING)	Public Works Department, Government of Madhya Pradesh, Bhopal
SHRI J. K. VISARIA	Pest Control (India) Pvt Ltd, Bombay
SHRI T. R. RAO	(<i>Alternate</i>)

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, NEW DELHI 110002

Telephones: 323 0131, 323 3375, 323 9402

Fax : 91 11 3234062, 91 11 3239399, 91 11 3239382

Telegrams : Manaksanstha
(Common to all Offices)

Central Laboratory:

Plot No. 20/9, Site IV, Sahibabad Industrial Area, Sahibabad 201010

Telephone

8-77 0032

Regional Offices:

Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg, NEW DELHI 110002 323 76 17

*Eastern : 1/14 CIT Scheme VII M, V.I.P. Road, Maniktola, CALCUTTA 700054 337 86 62

Northern : SCO 335-336, Sector 34-A, CHANDIGARH 160022 60 38 43

Southern : C.I.T. Campus, IV Cross Road, CHENNAI 600113 235 23 15

†Western : Manakalaya, E9, Behind Marol Telephone Exchange, Andheri (East),
MUMBAI 400093 832 92 95

Branch Offices:

'Pushpak', Nurmohamed Shaikh Marg, Khanpur, AHMEDABAD 380001 550 13 48

‡Peenya Industrial Area, 1st Stage, Bangalore-Tumkur Road,
BANGALORE 560058 839 49 55

Gangotri Complex, 5th Floor, Bhadbhada Road, T.T. Nagar, BHOPAL 462003 55 40 21

Plot No. 62-63, Unit VI, Ganga Nagar, BHUBANESHWAR 751001 40 36 27

Kalaikathir Buildings, 670 Avinashi Road, COIMBATORE 641037 21 01 41

Plot No. 43, Sector 16 A, Mathura Road, FARIDABAD 121001 8-28 88 01

Savitri Complex, 116 G.T. Road, GHAZIABAD 201001 8-71 19 96

53/5 Ward No. 29, R.G. Barua Road, 5th By-lane, GUWAHATI 781003 54 11 37

5-8-56C, L.N. Gupta Marg, Nampally Station Road, HYDERABAD 500001 20 10 83

E-52, Chitaranjan Marg, C-Scheme, JAIPUR 302001 37 29 25

117/418 B, Sarvodaya Nagar, KANPUR 208005 21 68 76

Seth Bhawan, 2nd Floor, Behind Leela Cinema, Naval Kishore Road,
LUCKNOW 226001 23 89 23

NIT Building, Second Floor, Gokulpat Market, NAGPUR 440010 52 51 71

Patliputra Industrial Estate, PATNA 800013 26 23 05

Institution of Engineers (India) Building 1332 Shivaji Nagar, PUNE 411005 32 36 35

T.C. No. 14/1421, University P.O. Palayam, THIRUVANANTHAPURAM 695034 6 21 17

*Sales Office is at 5 Chowringhee Approach, P.O. Princep Street,
CALCUTTA 700072 27 10 85

†Sales Office is at Novelty Chambers, Grant Road, MUMBAI 400007 309 65 28

‡Sales Office is at 'F' Block, Unity Building, Narashimaraja Square,
BANGALORE 560002 222 39 71