

IS : 6441 (Part IX) - 1973

Indian Standard (Reaffirmed 1997)

**METHODS OF TESTS FOR
AUTOCLAVED CELLULAR CONCRETE
PRODUCTS**

**PART IX JOINTING OF AUTOCLAVED CELLULAR
CONCRETE ELEMENTS**

(Second Reprint DECEMBER 1996)

UDC 666.973.6 : 693.224

© *Copyright* 1973

**BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002**

Indian Standard

METHODS OF TESTS FOR AUTOCLAVED CELLULAR CONCRETE PRODUCTS

PART IX JOINTING OF AUTOCLAVED CELLULAR CONCRETE ELEMENTS

Cement and Concrete Sectional Committee, BDC 2

<i>Chairman</i>	<i>Representing</i>
DR H. C. VISVESVARAYA	Cement Research Institute of India, New Delhi
<i>Members</i>	
DR A. S. BHADURI	National Test House, Calcutta
SHRI E. K. RAMACHANDRAN (<i>Alternate</i>)	Central Building Research Institute (CSIR), Roorkee
SHRI A. K. CHATTERJI	
DR S. S. REHSI (<i>Alternate</i>)	
DIRECTOR	Central Road Research Institute (CSIR), New Delhi
DR R. K. GHOSH (<i>Alternate</i>)	
DIRECTOR (CSMRS)	Central Water & Power Commission, New Delhi
DEPUTY DIRECTOR (CSMRS) (<i>Alternate</i>)	
SHRI K. H. GANGWAL	Hyderabad Asbestos Cement Products Ltd, Hyderabad
SHRI K. C. GHOSAL	Alokudyog Services Ltd, New Delhi
SHRI A. K. BISWAS (<i>Alternate</i>)	
DR R. K. GHOSH	Indian Roads Congress, New Delhi
DR R. R. HATTIANGADI	Associated Cement Companies Ltd, Bombay
SHRI P. J. JAOUS (<i>Alternate</i>)	
JOINT DIRECTOR, STANDARDS (B & S)	Research, Designs & Standards Organization, Lucknow
DEPUTY DIRECTOR, STANDARDS (B & S) (<i>Alternate</i>)	
SHRI S. B. JOSHI	S. B. Joshi & Co Ltd, Bombay
SHRI M. T. KANSE	Directorate General of Supplies & Disposals
SHRI S. L. KATHURIA	Roads Wing, Ministry of Transport & Shipping
SHRI S. R. KULKARNI	M. N. Dastur & Co (Private) Ltd, Calcutta
SHRI M. A. MEHTA	Concrete Association of India, Bombay
SHRI O. MUTHACHEN	Central Public Works Department
SUPERINTENDING ENGINEER, 2ND CIRCLE (<i>Alternate</i>)	

(Continued on page 2.)

© Copyright 1973

BUREAU OF INDIAN STANDARDS

This publication is protected under the *Indian Copyright Act (XIV of 1957)* and reproduction in whole or in part by any means except with written permission of the publisher shall be deemed to be an infringement of copyright under the said Act.

IS : 6441 (Part IX) - 1973

(Continued from page 1)

Members

SHRI ERACH A. NADIRSHAH
SHRI K. K. NAMBIAR

BRIQ NARESH PRASAD
COL J. M. TOLANI (Alternate)
PROF G. S. RAMASWAMY

DR N. S. BHAL (Alternate)
DR A. V. R. RAO
SHRI RAVINDER LAL (Alternate)
SHRI G. S. M. RAO
SHRI T. N. S. RAO
SHRI S. K. PINHEIRO (Alternate)

SECRETARY
SHRI R. P. SHARMA
SHRI MOHINDER SINGH (Alternate)

SHRI G. B. SINGH
SHRI C. L. KASLIWAL (Alternate)

SHRI J. S. SINGHOTA
SHRI T. C. GARG (Alternate)

SHRI R. K. SINHA
SHRI K. A. SUBRAMANIAM

SHRI P. S. RAMACHANDRAN (Alternate)
SHRI L. SWAROOP
SHRI A. V. RAMANA (Alternate)

SHRI D. AJITHA SIMHA,
Director (Civ Enng)

Representing

Institution of Engineers (India), Calcutta
In personal capacity (' Ramanalaya ', 11 First Crescent
Park Road, Gandhinagar, Adyar, Madras)
Engineer-in-Chief's Branch, Army Headquarters

Structural Engineering Research Centre (CSIR),
Roorkee

National Buildings Organization, New Delhi

Geological Survey of India, Nagpur
Gammon India Ltd, Bombay

Central Board of Irrigation & Power, New Delhi
Irrigation and Power Research Institute, Amritsar

Hindustan Housing Factory Ltd, New Delhi

Beas Designs Organization, Nangal Township

Indian Bureau of Mines, Nagpur
India Cements Ltd, Madras

Dalmia Cement (Bharat) Ltd, New Delhi

Director General, ISI (Ex-officio Member)

Secretary

SHRI Y. R. TANEJA

Deputy Director (Civ Enng), ISI

Precast Concrete Products Subcommittee, BDC 2 : 9

Convener

SHRI M. A. MEHTA Concrete Association of India, Bombay

Members

SHRI E. T. ANTIA (Alternate to
Shri M. A. Mehta)
SHRI V. A. ARTIHANOR Neyveli Lignite Corporation Ltd, Neyveli
SHRI T. RAMACHANDRAN (Alternate)
SHRI H. B. CHATTERJEE Hindustan Block Manufacturing Co Ltd, Calcutta
SHRI S. K. CHATTERJEE Hindustan Housing Factory Ltd, New Delhi
DEPUTY DIRECTOR, STANDARDS Research, Designs and Standards Organization,
(B & S) Lucknow
ASSISTANT DIRECTOR, STANDARDS
(M/C) (Alternate)
DIRECTOR (CSMRS) Central Water & Power Commission, New Delhi
DEPUTY DIRECTOR (CSMRS)
(Alternate)

(Continued on page 7)

Indian Standard

METHODS OF TESTS FOR AUTOCLAVED CELLULAR CONCRETE PRODUCTS

PART IX JOINTING OF AUTOCLAVED CELLULAR CONCRETE ELEMENTS

0. FOREWORD

0.1 This Indian Standard (Part IX) was adopted by the Indian Standards Institution on 22 March 1973, after the draft finalized by the Cement and Concrete Sectional Committee had been approved by the Civil Engineering Division Council.

0.2 Autoclaved cellular concrete is a class of material, which has been developed commercially abroad and is in the process of development in this country also. A series of Indian Standards on cellular concrete is being formulated so as to provide guidance in obtaining reliable products in autoclaved cellular concrete. The Sectional Committee has considered it desirable to issue a standard for the methods of tests for autoclaved cellular concrete products for the guidance of manufacturers and users.

0.3 In the formulation of this standard due weightage has been given to international co-ordination among the standards and practices prevailing in different countries in addition to relating it to the practices in the field in this country.

0.4 For convenience of reference, ' Indian Standard methods of tests for autoclaved cellular concrete products ' has been grouped into the following nine parts:

- Part I Determination of unit weight or bulk density and moisture content
- Part II Determination of drying shrinkage
- Part III Determination of thermal conductivity
- Part IV Corrosion protection of steel reinforcement in autoclaved cellular concrete
- Part V Determination of compressive strength
- Part VI Strength, deformation and cracking of flexural members subject to bending-short duration loading test

Part VII Strength, deformation and cracking of flexural members subject to bending-sustained loading test

Part VIII Loading tests for flexural members in diagonal tension

Part IX Jointing of autoclaved cellular concrete elements

0.5 In reporting the result of a test or analysis made in accordance with this standard, if the final value, observed or calculated, is to be rounded off, it shall be done in accordance with IS : 2-1960*.

1. SCOPE

1.1 This standard (Part IX) covers the procedure for testing the jointing of autoclaved cellular concrete flexural members, such as, floor and roof slabs.

2. TEST SPECIMENS

2.1 Size of Specimens — For determining the strength of joints a series, consisting of 3 specimens shall be tested. Each specimen shall consist of 3 element parts conforming in all respects to the requirements of the relevant Indian Standard (or the requirements specified by the manufacturer) in respect of shape and dimensions, but of length 0.5 m (see Fig. 1) jointed together.

2.1.1 Temperature of Specimen — The temperature of the specimen shall not be materially different from the ambient temperature in which it is being tested and in any case not less than 0°C.

2.1.2 Moisture Content of Specimen — The moisture content of the concrete during the test should be indicated and should be not less than 10 percent by weight when determined in accordance with IS : 6441 (Part I) - 1972†.

2.2 Jointing — The jointing shall be done in accordance with the directions of the manufacturer. If the manufacturer has prescribed a modified method of jointings for use in cold weather, the specimens jointed in that way shall also be tested in accordance with this procedure.

2.2.1 When no jointing material is required for interaction of loading between the adjacent elements, the jointing of specimens shall be done without the jointing material in accordance with the directions of the manufacturer.

*Rules for rounding off numerical values (revised).

†Methods of tests for autoclaved cellular concrete products: Part I Determination of unit weight or bulk density and moisture content.

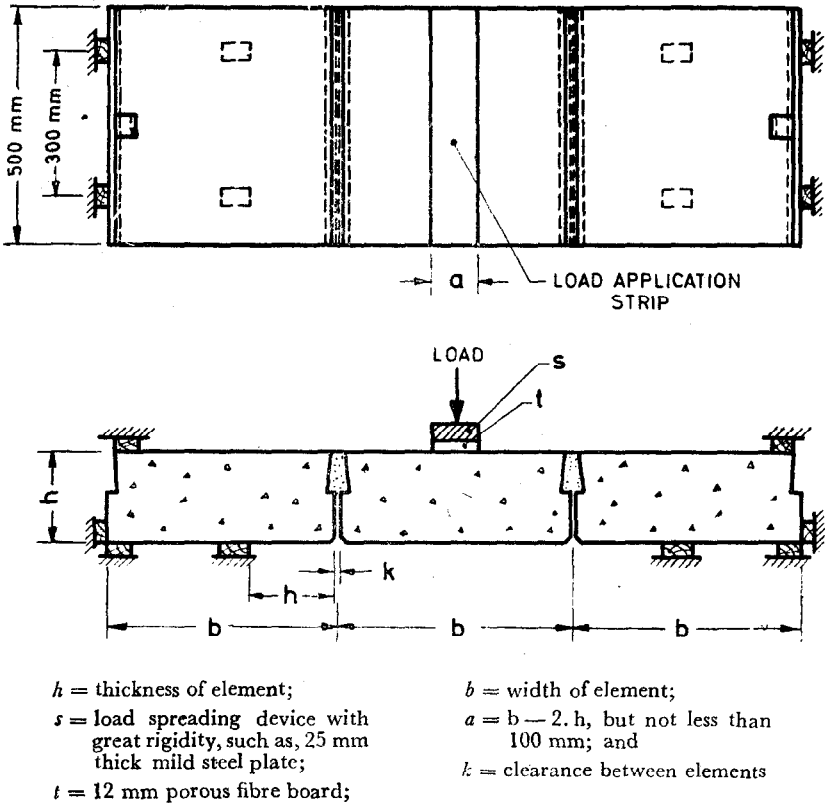


FIG. 1 LOADING ARRANGEMENT FOR JOINTED ELEMENTS OF CELLULAR CONCRETE

2.2.2 In case the interjacent element part has been supported, the support shall not be removed until the testing takes place.

2.3 Curing — The curing of the mortar shall be done according to the directions of the manufacturer. The specimens shall not be moved during the period between jointing and testing.

3. PROCEDURE

3.1 Laying on Supports — Each of the two external element parts shall be laid on three firm supports (see Fig. 1). Two of these shall be placed at a distance from the joint equal to the thickness of the element part and at a

distance of 300 mm from each other. The third support shall be placed at the external edge of the element parts. The supports shall be placed symmetrically from the centre line, perpendicular to the joints. The element part shall be fixed tightly to the external support, avoiding rising and sliding movements. Each support, shall have an area of about 50 cm². No pad-dings shall be used. If the joints are to be filled with cement mortar or some similar mortar, the laying of the specimen on the supports and fixing shall be done before the jointing.

3.2 Loading Appliances — The loading shall be applied with a linear load, along the centre line of the central element parallel to the joints and through a pad of porous fibre board, 12 mm thick (*see* Fig. 1). The load shall be uniformly distributed on an area of length 500 mm and width equal to the width of the element minus twice the height of the element, but in no case less than 100 mm.

3.3 Testing — The joint shall not be loaded earlier than the period recommended in the directions from the manufacturer. The increase of loading shall be effected at a rate of about 50 kg/min until rupture occurs. The loading at rupture shall be measured accurately with a maximum permissible deviation of ± 1.5 percent.

4. REPORTING TEST RESULTS

4.1 The strength of the jointing shall be calculated as the total load at rupture including the weight of the interjacent element part and the loading equipment expressed in kg/m.

4.1.1 For each specimen the strength of the jointing shall be expressed in kg/m and the mean value of the jointing strength, for the testing series, shall be expressed in kg/m rounded off in accordance with IS : 2-1960*

4.2 The test report shall indicate the following:

- a) Place, date and method of taking specimens;
- b) Specification, designation of the element;
- c) Designation of the joint design;
- d) Description of the jointing method;
- e) Rate of curing of the jointing material (wet erection);
- f) Joint strength for each particular specimen; and
- g) Mean value of the joint strength for the testing series.

*Rules for rounding off numerical values (*revised*).

(Continued from page 2)

<i>Members</i>	<i>Representing</i>
SHRI K. C. GHOSAL	Alokudyog Services Ltd, New Delhi
SHRI A. K. BISWAS (<i>Alternate</i>)	
SHRI V. G. GOKHALE	Bombay Chemicals Private Limited, Bombay
SHRI M. K. GUPTA	Himalayan Tiles & Marble Pvt Ltd, Bombay
SHRI B. D. JAYARAMAN	State Housing Board, Madras
SHRI B. K. JINDAL	Central Building Research Institute (CSIR), Roorkee
DR S. S. REHSI (<i>Alternate</i>)	
SHRI L. C. LAI	In personal capacity (<i>B/17 West End, New Delhi 23</i>)
SHRI G. C. MATHUR	National Buildings Organization, New Delhi
SHRI A. C. GUPTA (<i>Alternate</i>)	
SHRI S. NAHARAY	Engineering Construction Corporation Ltd, Madras
SHRI A. RAMAKRISHNA (<i>Alternate</i>)	
SHRI K. K. NAMBIAR	In personal capacity (<i>'Ramanalaya', 11 First Crescent Park Road, Gandhinagar, Adyar, Madras</i>)
SHRI RADHEY SHIAM	Engineer-in-Chief's Branch, Army Headquarters
SHRI B. G. SHIRKE	B. G. Shirke & Co, Poona
SHRI R. A. DESHMUKH (<i>Alternate</i>)	
SHRI C. N. SRINIVASAN	C. R. Narayana Road, Madras
SHRI C. N. RAGHAVENDRAN (<i>Alternate</i>)	
SURVEYOR OF WORKS (I)	Central Public Works Department
DR H. C. VISVESVARAYA	Cement Research Institute of India, New Delhi

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, NEW DELHI 110002

Telephones: 323 0131, 323 3375, 323 9402

Fax: 91 11 3234062, 91 11 3239399, 91 11 3239382

Telegrams : Manaksanstha
(Common to all Offices)

Central Laboratory :

Plot No. 20/9, Site IV, Sahibabad Industrial Area, Sahibabad 201010

Telephone

8-77 00 32

Regional Offices:

Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg, NEW DELHI 110002 323 76 17

*Eastern : 1/14 CIT Scheme VII M, V.I.P. Road, Maniktola, CALCUTTA 700054 337 86 62

Northern : SCO 335-336, Sector 34-A, CHANDIGARH 160022 60 38 43

Southern : C.I.T. Campus, IV Cross Road, CHENNAI 600113 235 23 15

†Western : Manakalaya, E9, Behind Marol Telephone Exchange, Andheri (East),
MUMBAI 400093 832 92 95

Branch Offices::

'Pushpak', Nurmohamed Shaikh Marg, Khanpur, AHMEDABAD 380001 550 13 48

‡Peenya Industrial Area, 1st Stage, Bangalore-Tumkur Road,
BANGALORE 560058 839 49 55

Gangotri Complex, 5th Floor, Bhadbhada Road, T.T. Nagar, BHOPAL 462003 55 40 21

Plot No. 62-63, Unit VI, Ganga Nagar, BHUBANESHWAR 751001 40 36 27

Kalaikathir Buildings, 670 Avinashi Road, COIMBATORE 641037 21 01 41

Plot No. 43, Sector 16 A, Mathura Road, FARIDABAD 121001 8-28 88 01

Savitri Complex, 116 G.T. Road, GHAZIABAD 201001 8-71 19 96

53/5 Ward No.29, R.G. Barua Road, 5th By-lane, GUWAHATI 781003 54 11 37

5-8-56C, L.N. Gupta Marg, Nampally Station Road, HYDERABAD 500001 20 10 83

E-52, Chitaranjan Marg, C-Scheme, JAIPUR 302001 37 29 25

117/418 B, Sarvodaya Nagar, KANPUR 208005 21 68 76

Seth Bhawan, 2nd Floor, Behind Leela Cinema, Naval Kishore Road,
LUCKNOW 226001 23 89 23

NIT Building, Second Floor, Gokulpat Market, NAGPUR 440010 52 51 71

Patliputra Industrial Estate, PATNA 800013 26 23 05

Institution of Engineers (India) Building 1332 Shivaji Nagar, PUNE 411005 32 36 35

T.C. No. 14/1421, University P. O. Palayam, THIRUVANANTHAPURAM 695034 6 21 17

*Sales Office is at 5 Chowringhee Approach, P.O. Princep Street,
CALCUTTA 700072 27 10 85

†Sales Office is at Novelty Chambers, Grant Road, MUMBAI 400007 309 65 28

‡Sales Office is at 'F' Block, Unity Building, Narashimaraaja Square,
BANGALORE 560002 222 39 71