

800/CEJZ/FZR-14/15-16 / *as* /BR

*28* May 2016


M/S RHG Constructions,  
& SCO 7-8, 3<sup>rd</sup> floor, Jandu Tower,  
Miller Ganj, GT Road, Ludhiana -141003

**CA NO. CEJZ/FZR-14/20.15-16 : PROVN OF OTM ACCN FOR LIGHT  
AD REGT AT DHOLEWAL/LUDHIANA**

Dear Sir,

1. It is intimated that Design mix M-25 in respect of the subject work carried out by Command Test Lab Chandigarh has been received with the result not meeting the required strength of 28 days cubes as per IS/CA , and cement also not meeting the requisite criteria as per IS/CA.
2. In view of the above all the cement works including RCC M-25 design mix will not be further carried out till the approval of new design mix.
3. However, the works other than cement works, RCC M-25 design mix like, layout of bldgs, excavation, fabrication and tying of steel reinforcement and form work etc can be carried out so that progress of the work is not affected

Yours faithfully,

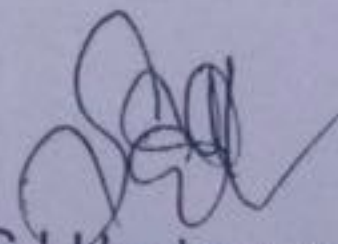

( S I Hashmy )  
AE (Civ)  
AGE B/R Ludhiana

Copy to :-

GE Ludhiana

- for info and further necessary action please.